Executive Order G-70-175
Figure 2A-2
AST V/R Piping Schematic (Typical)

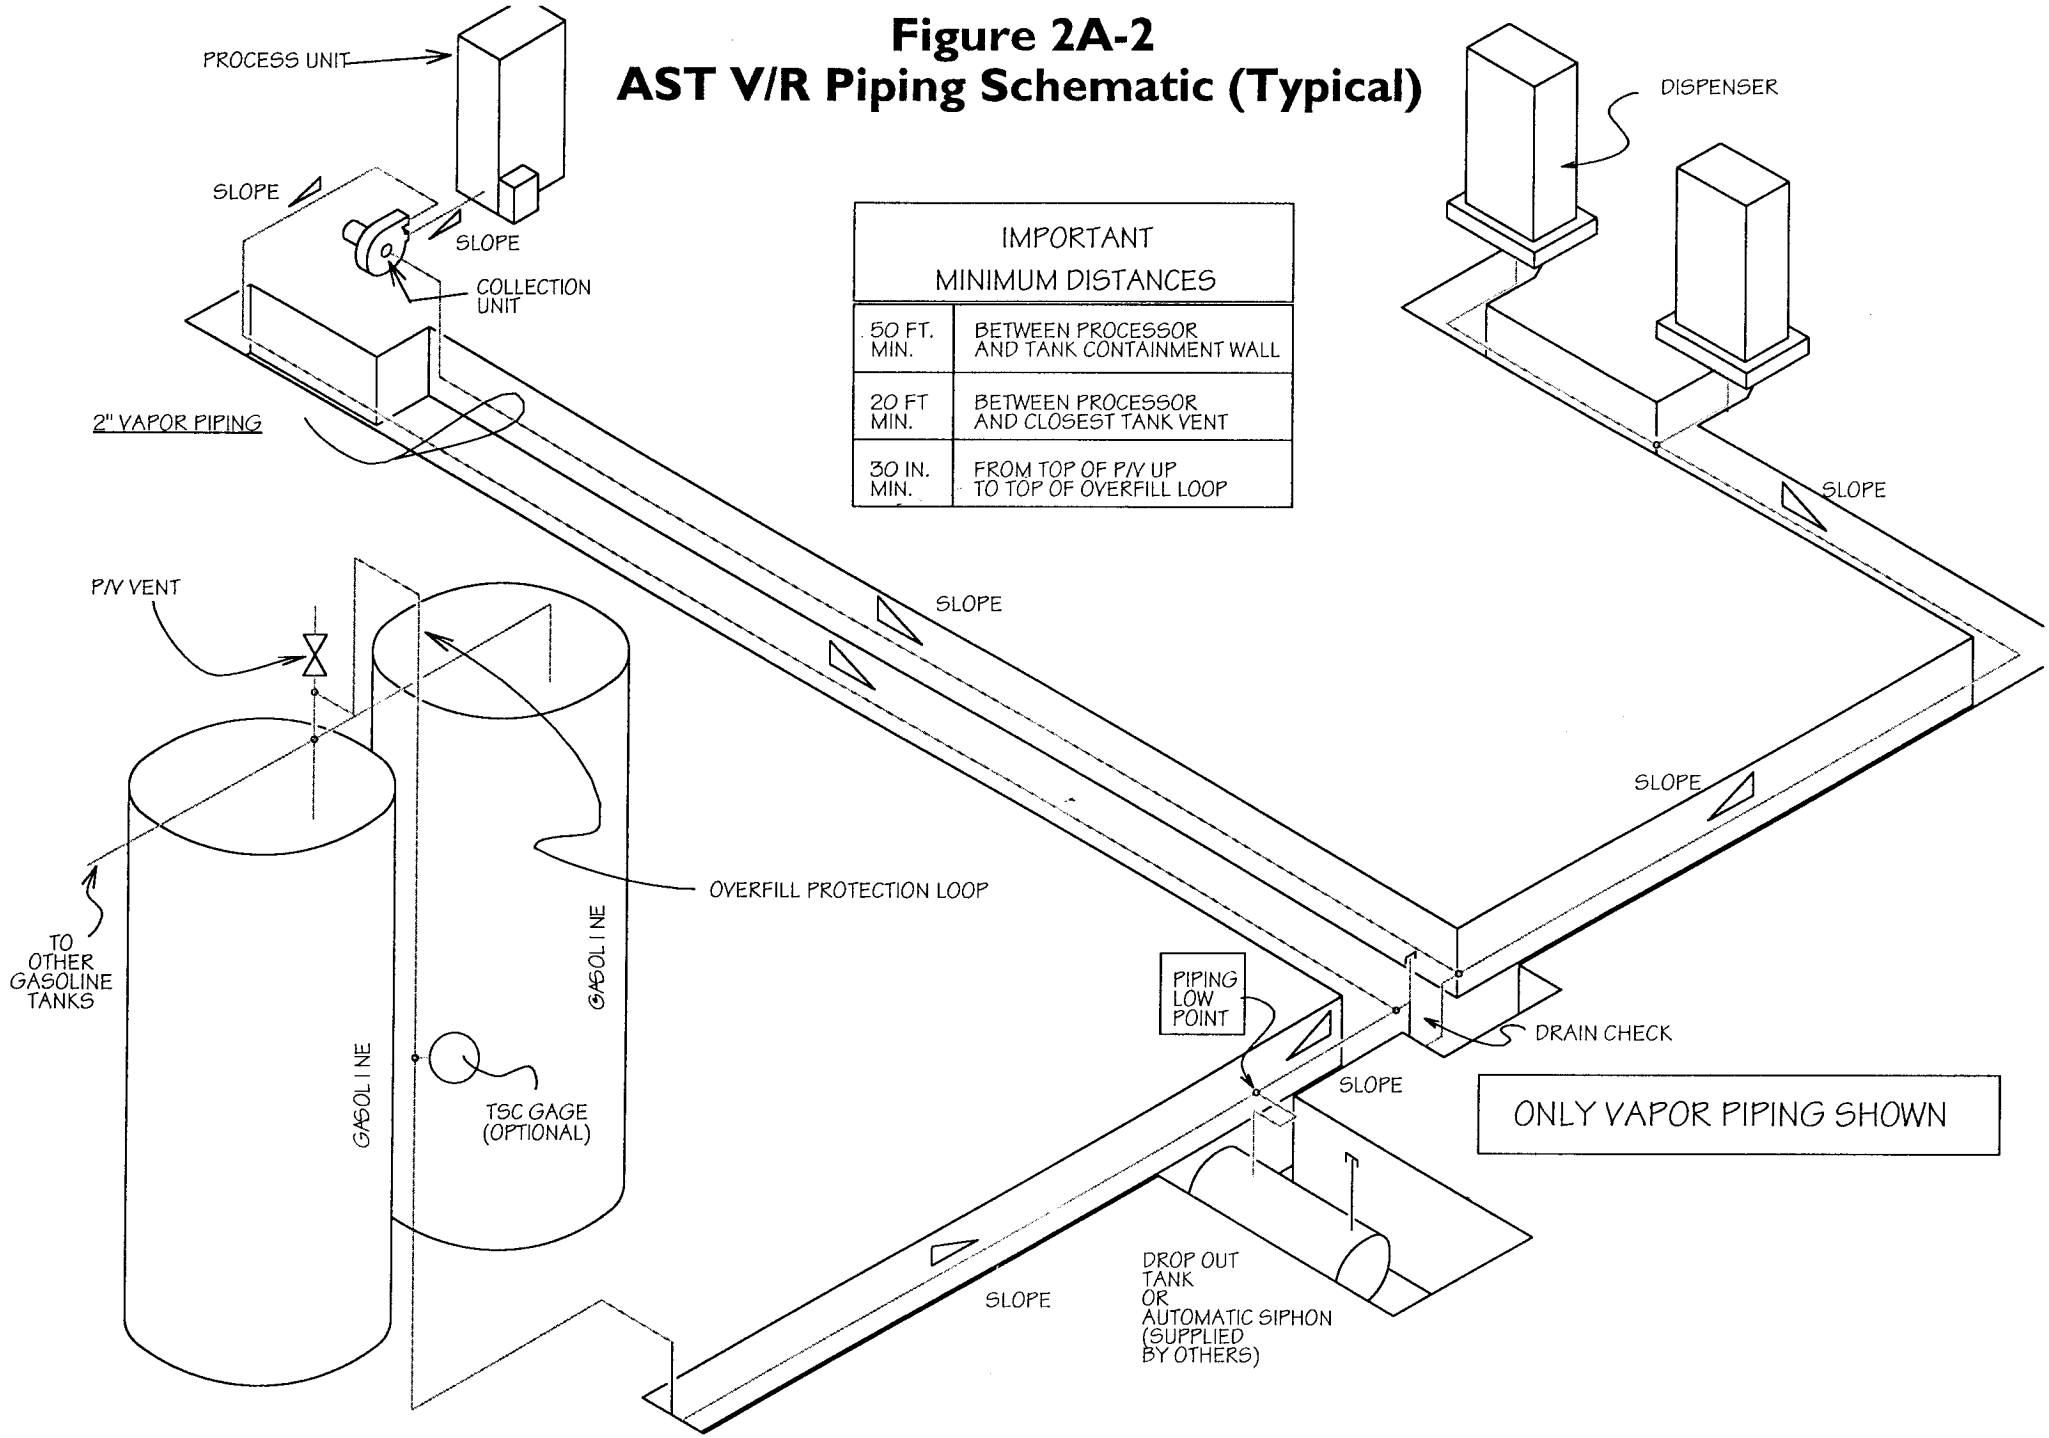

IMPORTANT MINIMUM DISTANCES	
50 FT. MIN.	BETWEEN PROCESSOR AND TANK CONTAINMENT WALL
20 FT MIN.	BETWEEN PROCESSOR AND CLOSEST TANK VENT
30 IN. MIN.	FROM TOP OF P/V UP TO TOP OF OVERFILL LOOP