Executive Order G-70-175

Figure 2B-3
Control Panel

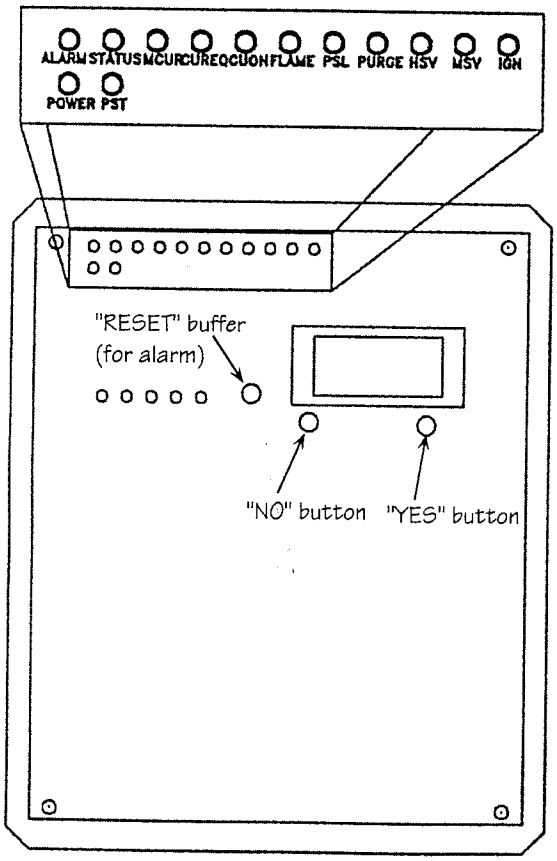

Key to LEDs:

ALARM =>Alarm Condition
CUON =>Collection Unit Active
CUREQ =>Dispenser Active
FLAME =>Processing Vapors
HSV =>High Volume Processing
IGN =>Initiate Processing
MCUR =>Collection Unit Sensor
MSV => Main Processor Valve Open
POWER =>Panel Power
PSL =>Processor Pressure
PST =>Tank Ullage Pressure
PURGE =>Clearing Lines
STATUS =>Not Used